



Testa protokols

Pasūtījums PD6_izklašanas

Serija: K2

Tests: Compression test

Izgatavosanas datums: 25.11.2020 13:45

Standarts: EN 12390-3:2009

Parauga vecums: 54 00:16

Paraugs: Cube 150x150x150

Testa datums: 18.01.2021 14:01

Concrete class-----


Testus veica: A. Dandens

Quality result conformity EN 206:2013: not possible

Pasūtītājs U. Skadinš


Name	Length [mm]	Width [mm]	Height [mm]	Weight [g]	Bulk density [kg/m ³]	Breakload [kN]	Strength [MPa]
1	153	151	151	8100	2340	1020,5	44,4
	Break type:						
2	152	150	151	8100	2360	1012,5	44,4
	Break type:						
3	151	151	151	8100	2360	1058,0	47,0
	Break type:						
4	151	150	150	8100	2370	978,2	43,5
	Break type:						
Average					2360		44,8
Std. dev					14,71		1,53

Paraugs 1

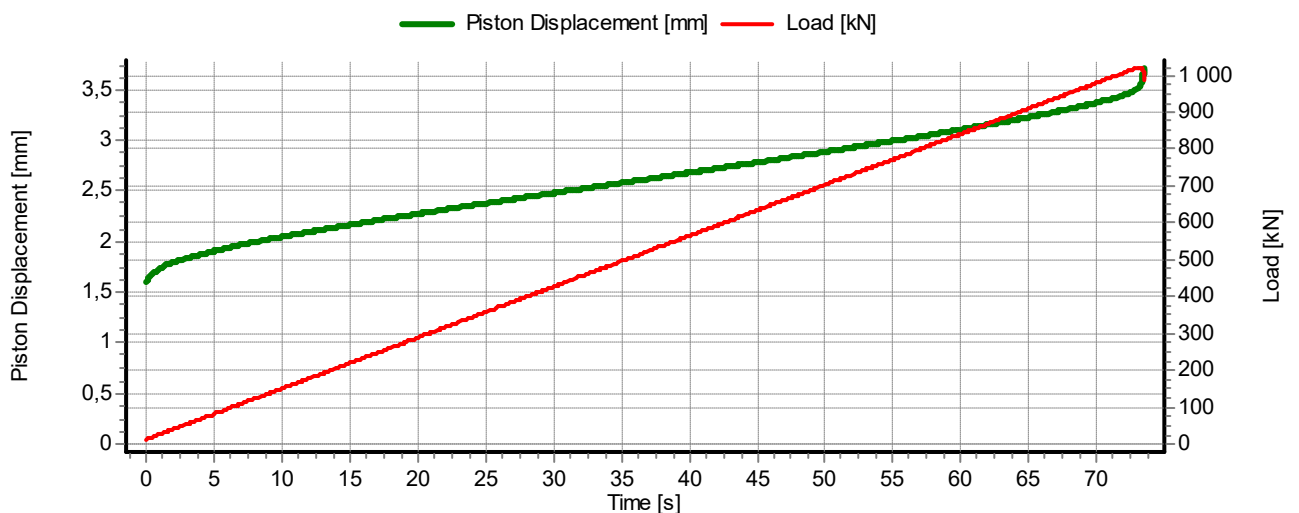




Paraugs 2

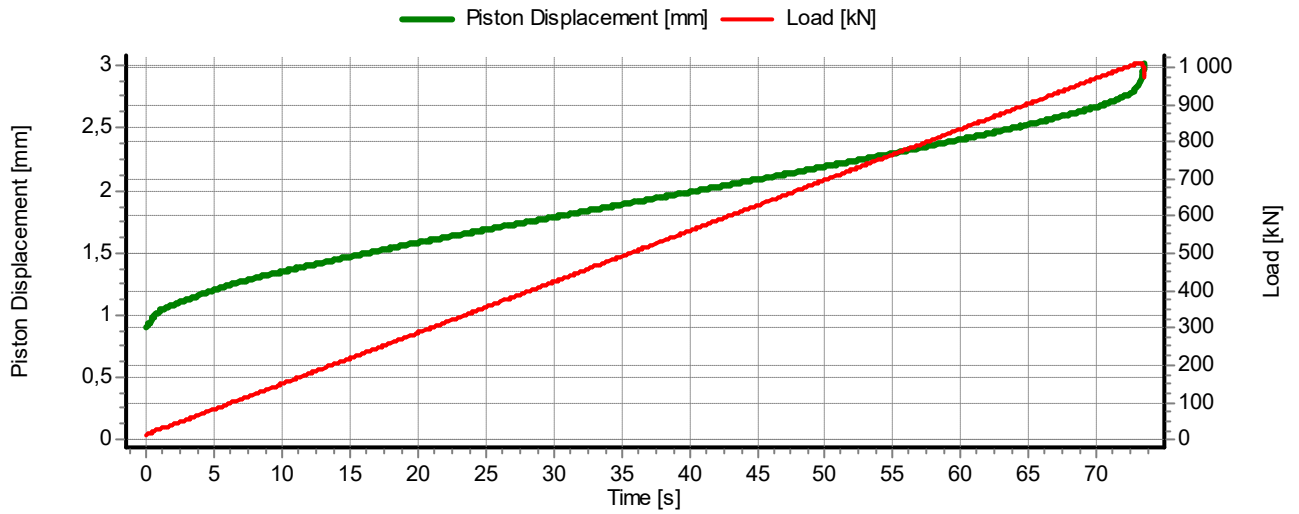

Paraugs 3

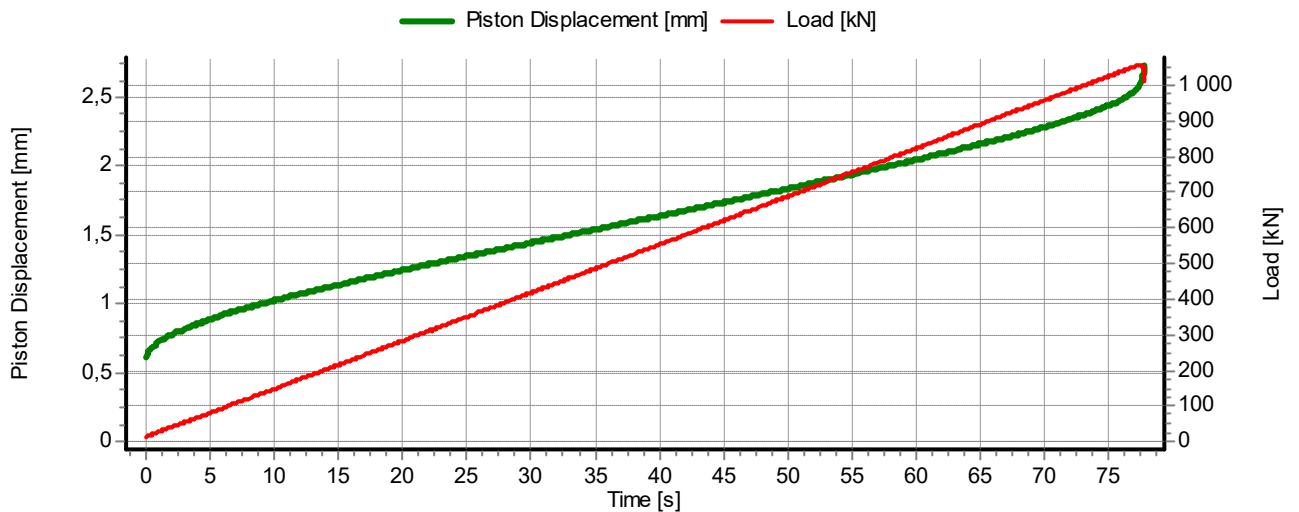

Paraugs 4

